


LA500-508 INSTALLATION GUIDE

NOTE:- AIR PRESSURE INTO UNIT IS < 0.5 BAR

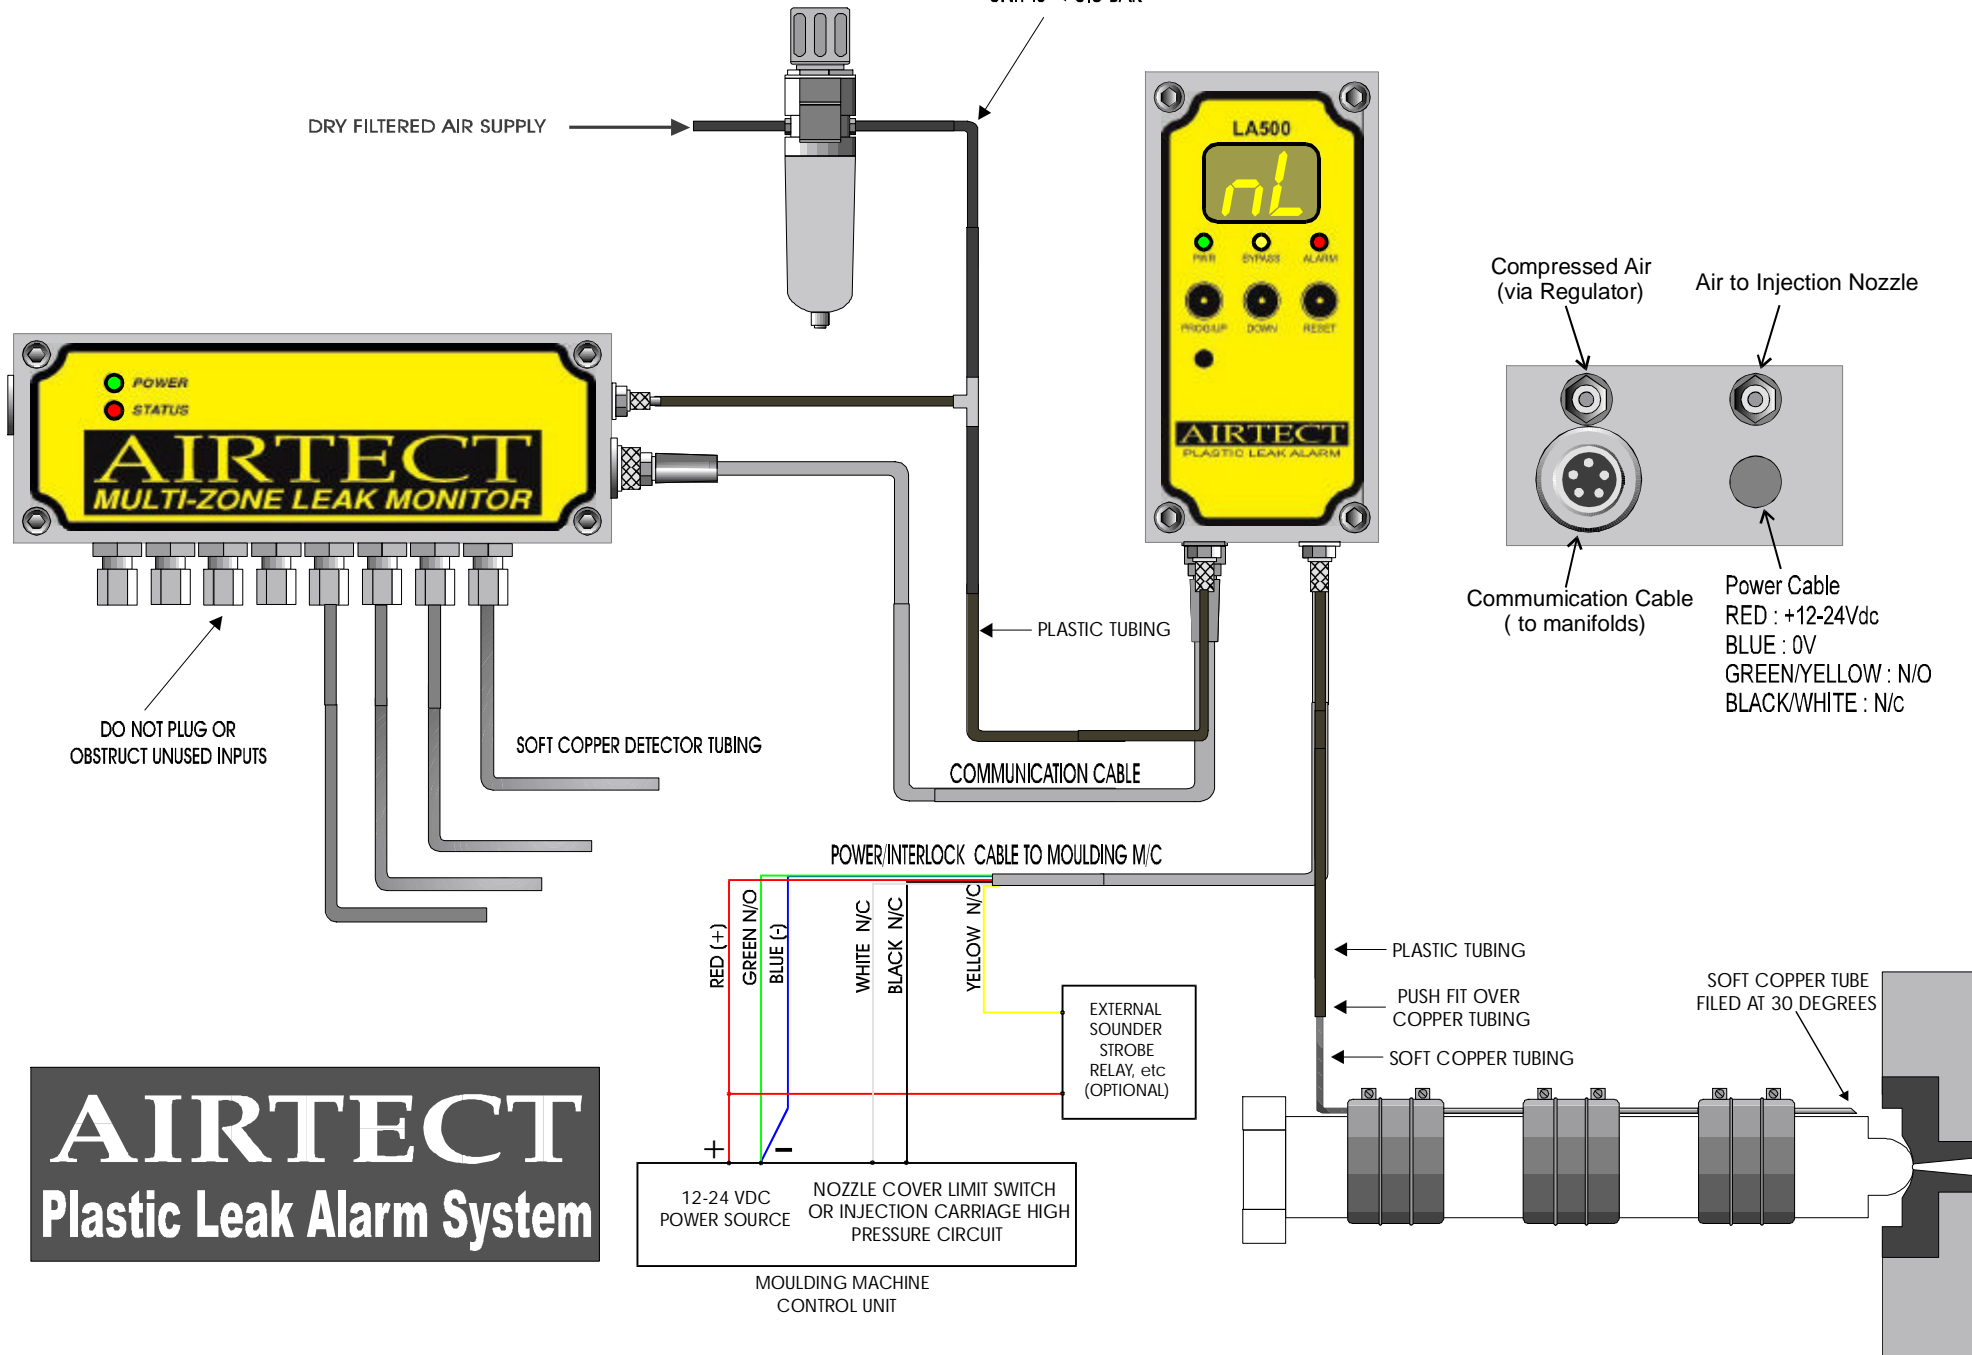

AIRTECT
Plastic Leak Alarm System